



**CECIL COUNTY
HEALTH
DEPARTMENT**


Speaker Contact Information

Angela Scramlin, R.S.


Environmental Health Services

410-996-5160



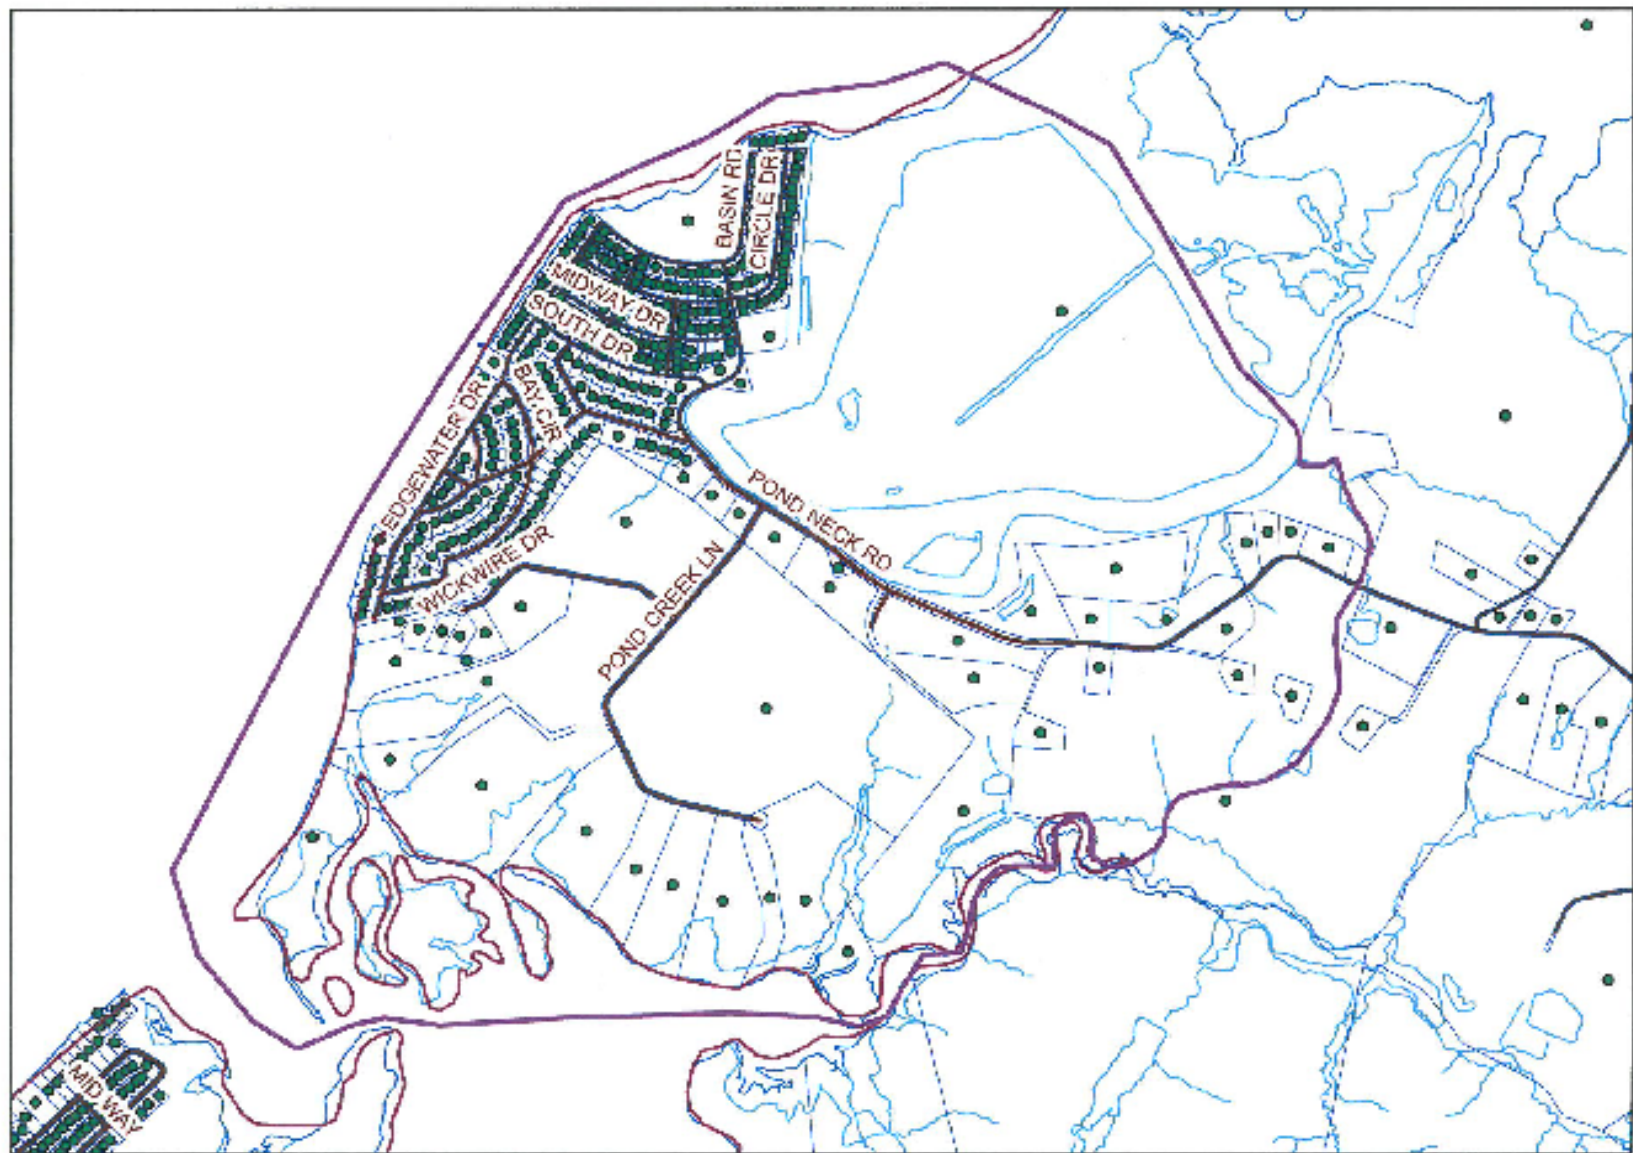

1 inch = 1,500 feet



Pearce Creek Dredge Disposal Water Results Data - Cecil County Health Department 2011-12

Well Depth	Address	Untreated-As	Untreated-Be	Untreated-Ni	Untreated-Fe	Untreated-Mn	Treated-As	Treated-Be	Treated-Ni	Treated-Fe	Treated-Mn
Maximum & Recommended MCL's		0.01	0.004	0.1	0.3	0.05	0.01	0.004	0.1	0.3	0.05
43	Edgewater Drive	<0.002	0.006	<0.05	<0.1	7.38	<0.002	<0.001	<0.05	<0.1	<0.05
43	Basin Road	<0.002	<0.001	<0.05	<0.1	0.06					
46	Edgewater Drive	<0.002	<0.001	<0.05	<0.1	<0.05					
50	Edgewater Drive	<0.002	0.007	0.07	<0.1	13.22	<0.002	<0.001	<0.05	<0.1	<0.05
50	Circle Drive	<0.002	<0.001	<0.05	6.03	3.83	<0.002	<0.001	<0.05	<0.1	<0.05
50	Edgewater Drive	<0.002	<0.001	<0.05	<0.1	4.35					
51	Edgewater Drive	0.002	0.001	<0.05	0.5	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
53	Edgewater Drive	<0.002	0.01	0.09	0.42	14.22	<0.002	<0.001	<0.05	<0.1	0.52
53	Midway Drive	<0.002	<0.001	<0.05	0.16	0.89	<0.002	<0.001	<0.05	<0.1	<0.05
53	Edgewater Drive						<0.002	<0.001	<0.05	<0.1	<0.05
55	Edgewater Drive	<0.002	<0.001	<0.05	<0.1	<0.05					
55	Bay Circle	<0.002	0.003	<0.05	<0.1	2.72	<0.002	<0.001	<0.05	<0.1	<0.05
57	Maryland Drive	<0.002	0.001	<0.06	0.18	4.45	<0.002	<0.001	<0.05	<0.1	<0.05
58	Chesapeake Circle	<0.002	<0.001	<0.05	<0.1	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
58	South Drive	<0.002	<0.001	<0.05	4.07	0.89	<0.002	<0.001	<0.05	<0.1	<0.05
58	Maryland Drive	<0.002	0.001	0.08	<0.1	2.94	<0.002	<0.001	<0.05	<0.1	<0.05
61	Edgewater Drive	<0.002	0.01	0.16	4.35	15.74	<0.002	<0.001	<0.05	<0.1	0.06
62	Circle Drive	<0.002	<0.001	<0.05	<0.1	0.06					
65	Bay Circle	0.002	0.009	0.14	11.23	29.84	<0.002	<0.001	<0.05	<0.1	<0.05
65	Bay Circle	<0.002	<0.001	<0.05	<0.1	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
67	Bay Circle	<0.002	<0.001	<0.05	<0.1	<0.05					
70	South Drive	<0.002	0.002	<0.05	<0.1	2.85	<0.002	<0.001	<0.05	<0.1	<0.05
70	Edgewater Drive	0.005	0.013	0.28	<0.1	24.35	<0.002	<0.001	<0.05	<0.1	0.33
71	Bay Circle	<0.002	<0.001	<0.05	0.15	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
73	Bay Circle	<0.002	<0.001	<0.05	<0.1	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
75	Edgewater Drive	<0.002	<0.001	<0.05	<0.1	0.08	<0.002	<0.001	<0.05	<0.1	<0.05
79	Bay Circle	<0.002	<0.001	<0.05	<0.1	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
83	Circle Drive	0.002	<0.001	<0.05	94.83	13.37	0.004	<0.001	<0.05	<0.1	<0.05
85	Edgewater Drive	<0.002	<0.001	<0.05	<0.1	<0.05	<0.002	<0.001	<0.05	<0.1	<0.05
85	Midway Drive	0.007	0.008	0.58	35.96	86.88	<0.002	<0.001	<0.05	0.65	2.22
88	Circle Drive	0.051	<0.001	<0.05	153.3	10.41	0.058	<0.001	<0.05	<0.1	<0.05
95	Bay Circle	<0.002	0.001	<0.05	<0.1	0.06	<0.002	<0.001	<0.05	<0.1	<0.05
109	Edgewater Drive	<0.002	<0.001	<0.05	1.18	0.43	<0.002	<0.001	<0.05	<0.1	<0.05
110	Elk Drive	<0.002	<0.001	<0.05	29.14	0.33					
115	Bay Circle	<0.002	<0.001	0.08	0.513	0.22	<0.002	<0.001	<0.05	<0.1	<0.05
183	Pond Neck Rd	0.002	0.008	0.29	68.15	45.93	<0.002	<0.001	<0.05	<0.1	0.16
208	South Drive	<0.002	<0.001	<0.05	145.44	5.04	<0.002	<0.001	<0.05	<0.1	<0.05
250	Maryland Drive	<0.002	<0.001	<0.05	17.37	0.11	<0.002	<0.001	<0.05	<0.1	<0.05
270	South Drive	<0.002	<0.001	<0.05	20.2	0.14	<0.002	<0.001	<0.05	<0.1	<0.05



Sample result below laboratory detection level for element



Sample result detected but below Maximum or Recommended Contaminant Level



Sample result above Maximum or Recommended Contaminant Level

For more information or questions, please contact
Health Department, Environmental Health Services Division at 410-996-5160.

Cecil County